



KGK-KIP-005-2025

RFx: 5000016523

**TENDER FOR SUPPLY AND INSTALLATION, OF 11KV INDOOR METAL CLAD SWITCHGEAR PANEL & UNDERGROUND
CABLE FOR KIPEVU III POWER STATION
(CITIZEN CONTRACTORS)**

21st March, 2025

CLARIFICATION No.1

In accordance with the “Tender for Supply and Installation of 11KV Indoor Metal Clad Switchgear Panel & Underground Cable for Kipevu III Power Station,” KenGen hereby issues, Clarification No.1


ITEM	BIDDER’S CLARIFICATION	KENGEN RESPONSE
1.	We are participating in the subject tender for Supply and Installation Of 11kv Indoor Metal Clad Switchgear Panel & Underground Cable for Kipevu III Power Station. Kindly please provide the Single Line Diagram or drawings.	Please find the drawings attached as; Appendix i -KDPI SLD Interconnection Appendix ii - KDP3 SLD Interconnection


ACKNOWLEDGEMENT OF CLARIFICATION No. 1

We, the undersigned hereby certify that the Clarification is an integral part of the document and the alterations set out in the clarification have been incorporated in the tender proposal.

Signed.....

Tenderer **Samped**

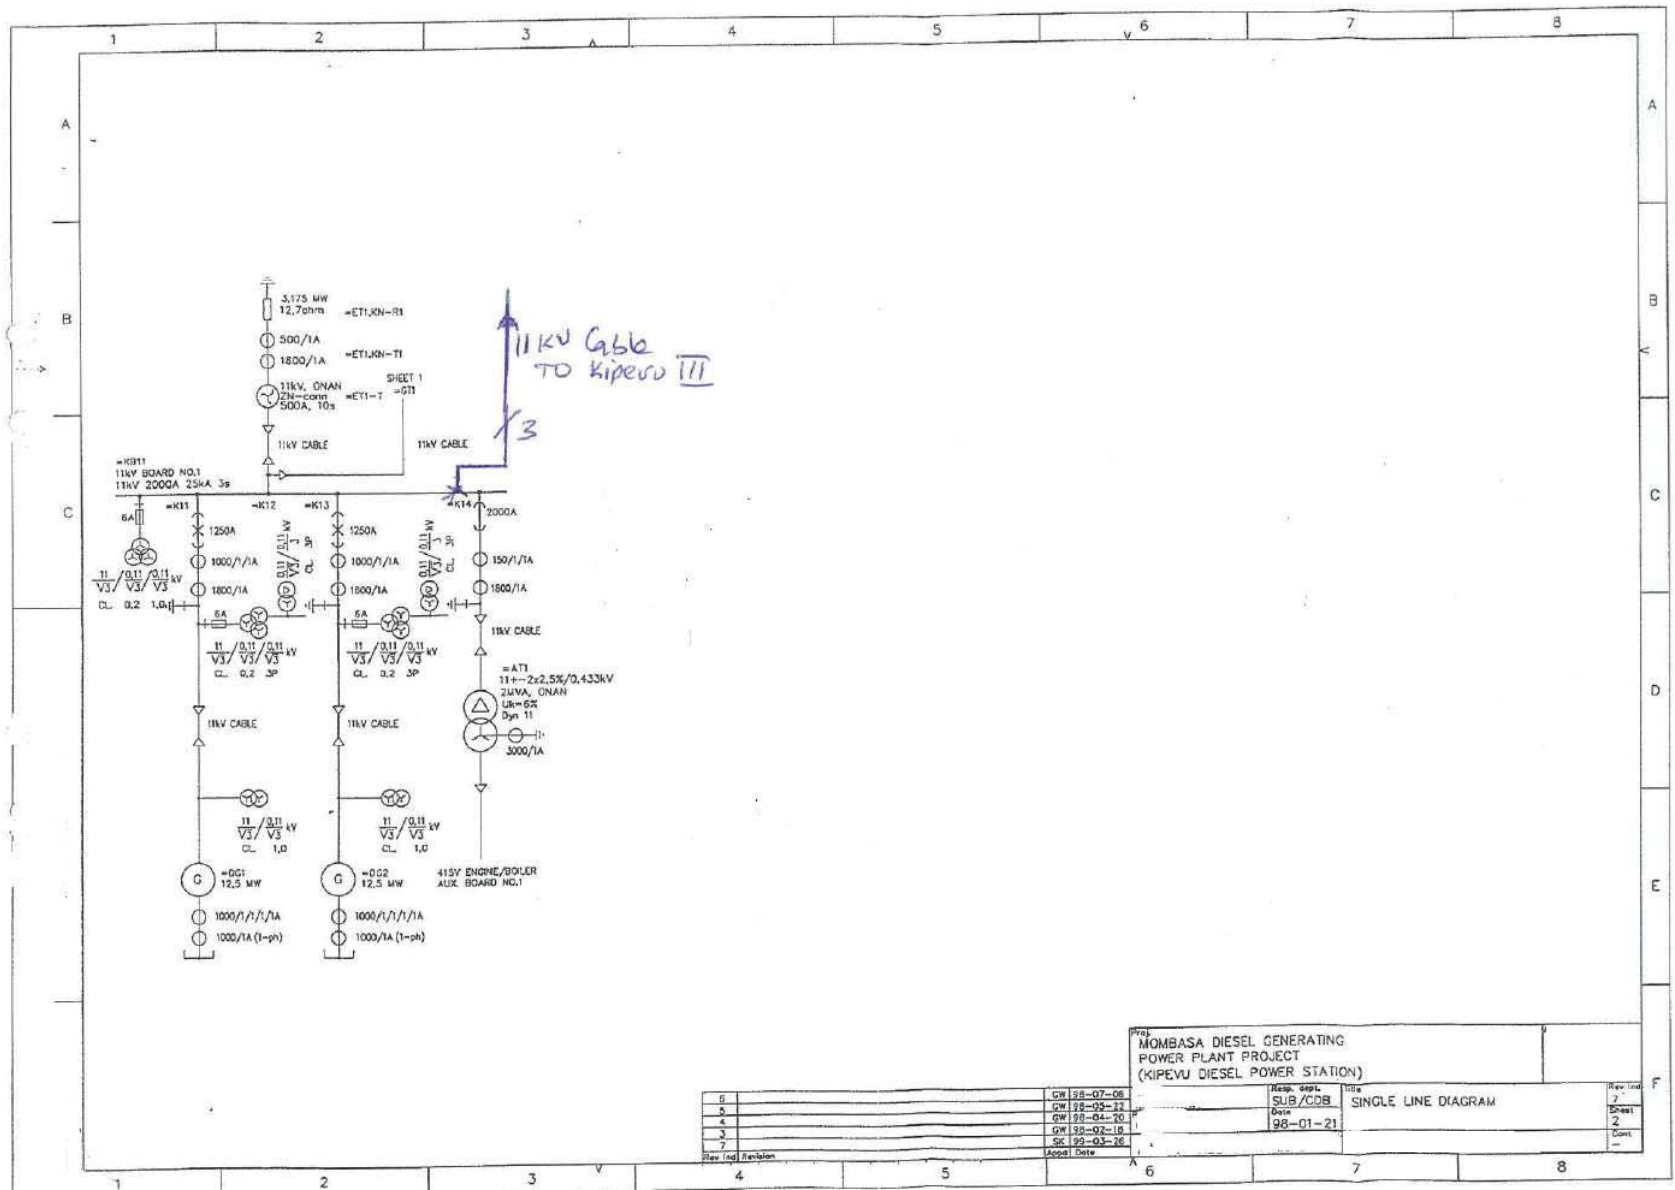


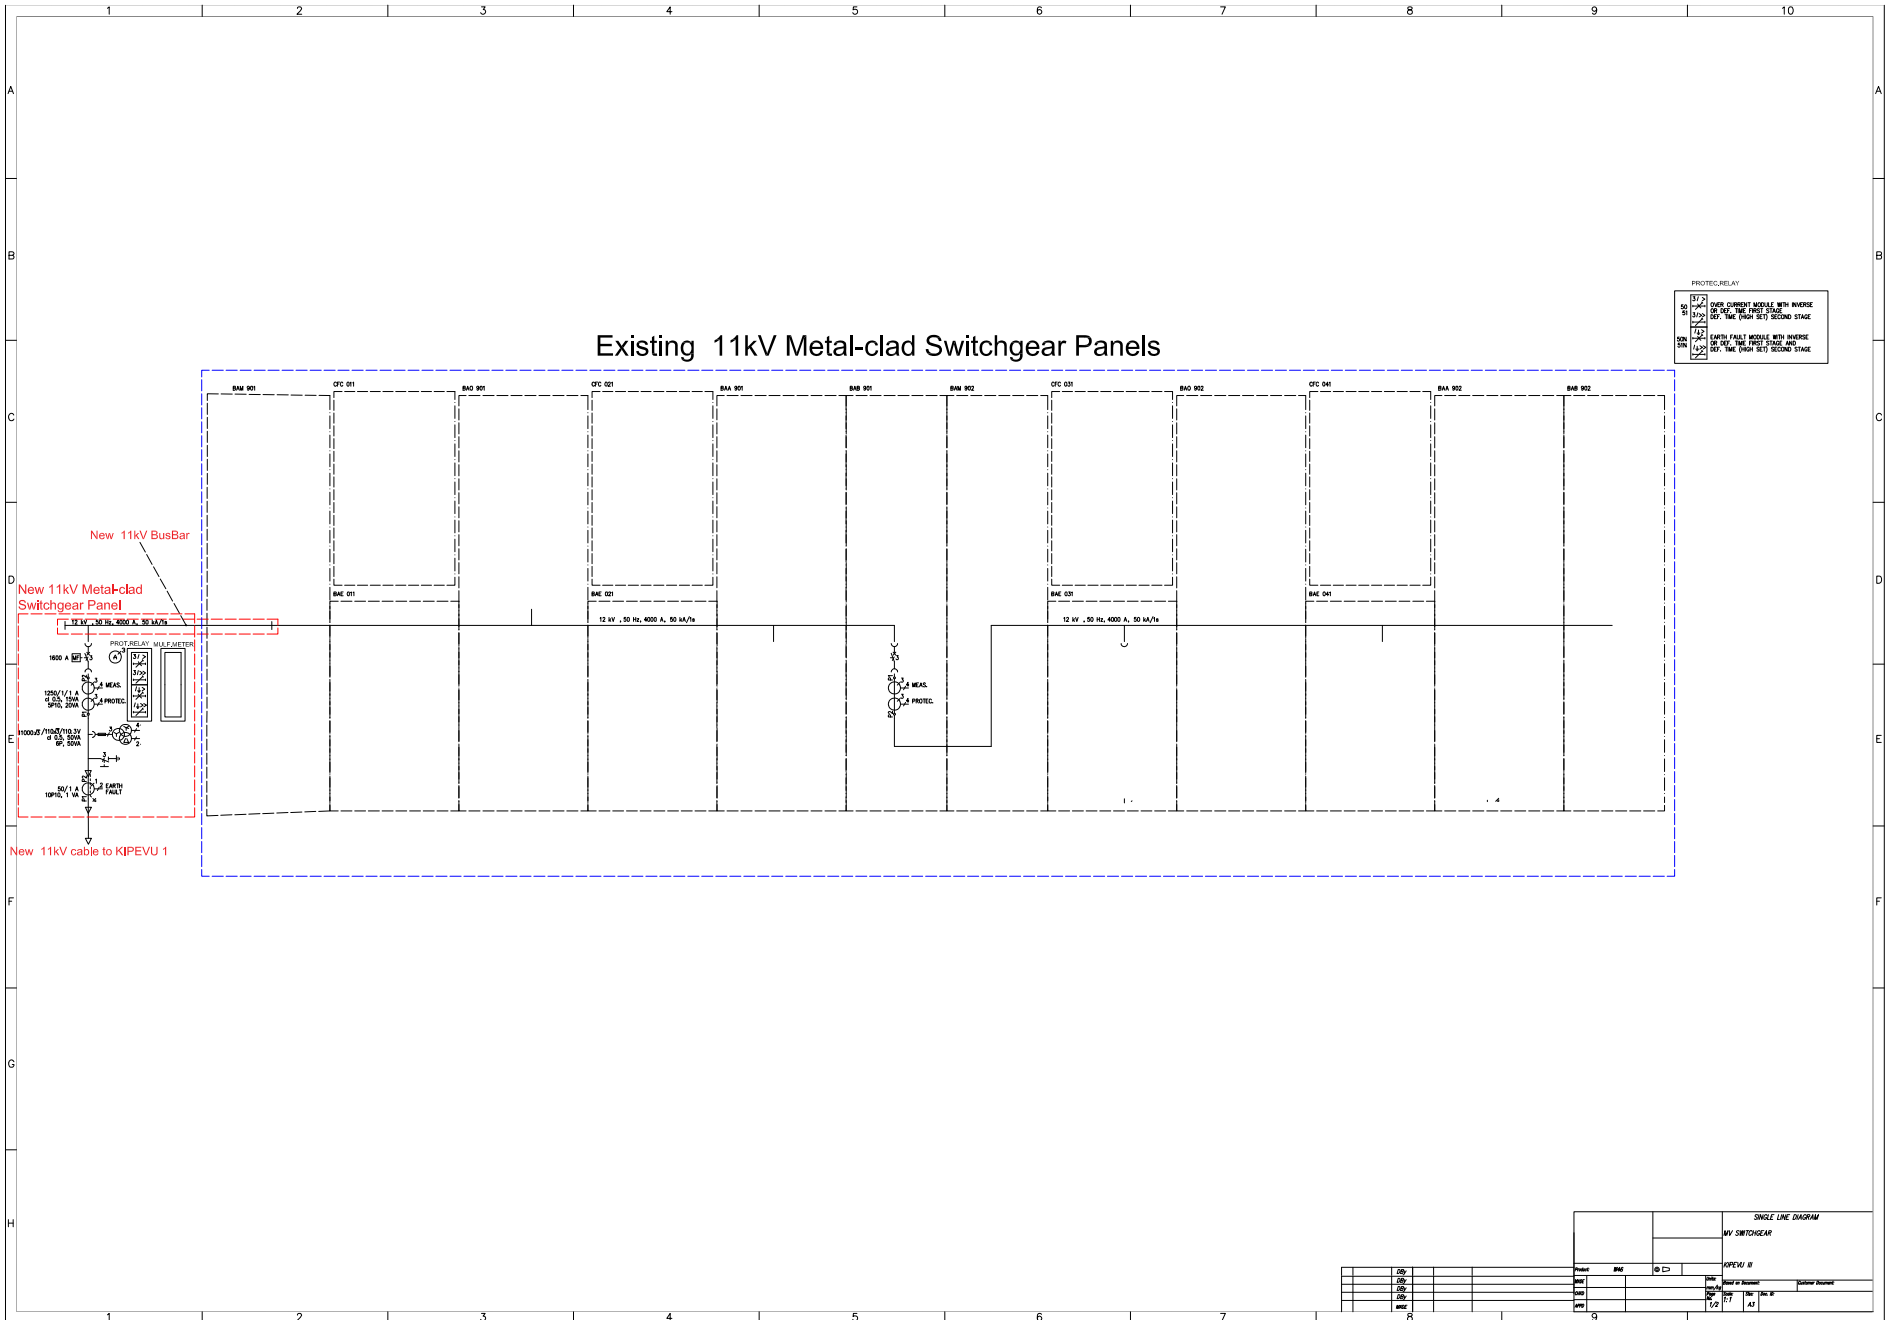

Existing 11kV Metal-clad Switchgear Panels

PROTEC.RELAY

01	OVER CURRENT MODULE WITH INVERSE
02	50 Hz, 120V, 1.5A
03	DEF. TIME DRIFT SELV SECOND STAGE
04	50 Hz, 120V, 1.5A
05	50 Hz, 120V, 1.5A
06	50 Hz, 120V, 1.5A
07	50 Hz, 120V, 1.5A
08	50 Hz, 120V, 1.5A
09	50 Hz, 120V, 1.5A
10	50 Hz, 120V, 1.5A
11	50 Hz, 120V, 1.5A
12	50 Hz, 120V, 1.5A
13	50 Hz, 120V, 1.5A
14	50 Hz, 120V, 1.5A
15	50 Hz, 120V, 1.5A
16	50 Hz, 120V, 1.5A
17	50 Hz, 120V, 1.5A
18	50 Hz, 120V, 1.5A
19	50 Hz, 120V, 1.5A
20	50 Hz, 120V, 1.5A
21	50 Hz, 120V, 1.5A
22	50 Hz, 120V, 1.5A
23	50 Hz, 120V, 1.5A
24	50 Hz, 120V, 1.5A
25	50 Hz, 120V, 1.5A
26	50 Hz, 120V, 1.5A
27	50 Hz, 120V, 1.5A
28	50 Hz, 120V, 1.5A
29	50 Hz, 120V, 1.5A
30	50 Hz, 120V, 1.5A

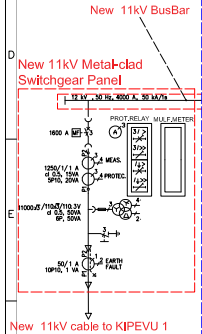

New 11kV cable to KPEVU 1

SINGLE LINE DIAGRAM		BY SWITCHGEAR		KPEVU 1	
Phase	BM	BM	BM	BM	BM
01					
02					
03					
04					
05					
06					
07					
08					
09					
10					
11					
12					
13					
14					
15					
16					
17					
18					
19					
20					
21					
22					
23					
24					
25					
26					
27					
28					
29					
30					