



# KenGen

KENYA ELECTRICITY GENERATING COMPANY PLC

RFx 5000008633

**TENDER FOR SUPPLY OF 66KV BUSHINGS & MACHINE SPARES FOR TANA POWER STATION.**

**(Citizen Contractor)**

**TENDER No. KGN-HYD(Tana)-05-2021**


30<sup>th</sup> December, 2021

## CLARIFICATION NO. 1

In accordance with the **Tender for Supply Of 66KV Bushings & Machine Spares for Tana Power Station.**, KenGen hereby issues Clarification 1 as follows;

No.	Bidder's Question	KenGen's Response
1	Please clarify on the rated voltage data of Current transformer 600A, 400A, 2500A, 50A. Every manufacturer i contacted asked for the rated Voltages, assist on that	The current transformers are intended for use in a 11kV circuit. Let them refer to 'MAG ELECTRIC Co. TYPE AM12' for guidance.
2	Please provide name plate pictures of Cts so that we can get the best quality.	As per below picture provided.

PICTURE;

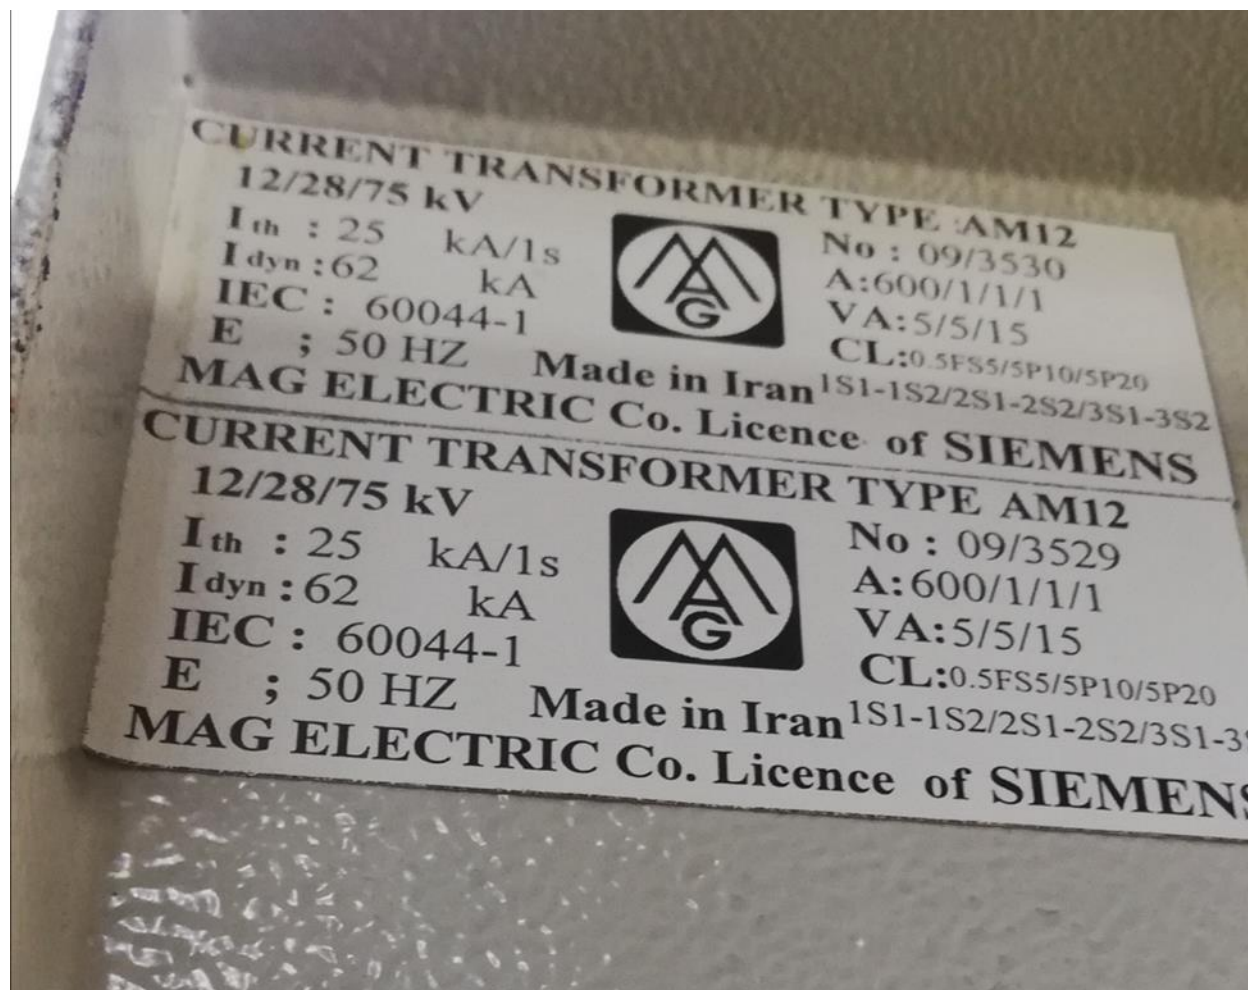

**ACKNOWLEDGEMENT OF CLARIFICATION NO 1**

We, the undersigned hereby certify that Clarification is an integral part of the document and has been incorporated in the Tender document.

Signed.....

Tenderer.....

Date.....